


ENSURE TANK CAN EASILY WITHSTAND HEAD OF WATER AVAILABLE  
 ALLOW FOR AT LEAST 10MM INSULATION ALL AROUND THE TANK. USE PLYWOOD OR SIMILAR UNDER THE TANK TO PREVENT HEAT LOSS BY CONDUCTION THROUGH THE SUPPORT FRAME  
 ENSURE TANK IS SAFELY SUPPORTED

2" (min 1.5") OPEN VENT CONNECTION AT HIGHEST POINT. IF NECESSARY FIT TWO OPEN VENTS AT SUITABLE POINTS IN TANK TO ENSURE NO AIR CAN BE TRAPPED)

\* OUTLET & RETURN DIMS WILL VARY WITH BOILER AND HEAT LOAD  
 PLEASE CHECK SIZES WITH TEISEN PRODUCTS LTD. BEFORE PRODUCTION  
 SEE DRAWING "TYPICAL BOILER AND ACCUMULATOR SYSTEM"  
 ADDITIONAL SOCKETS ETC MAY BE ADDED IF REQUIRED

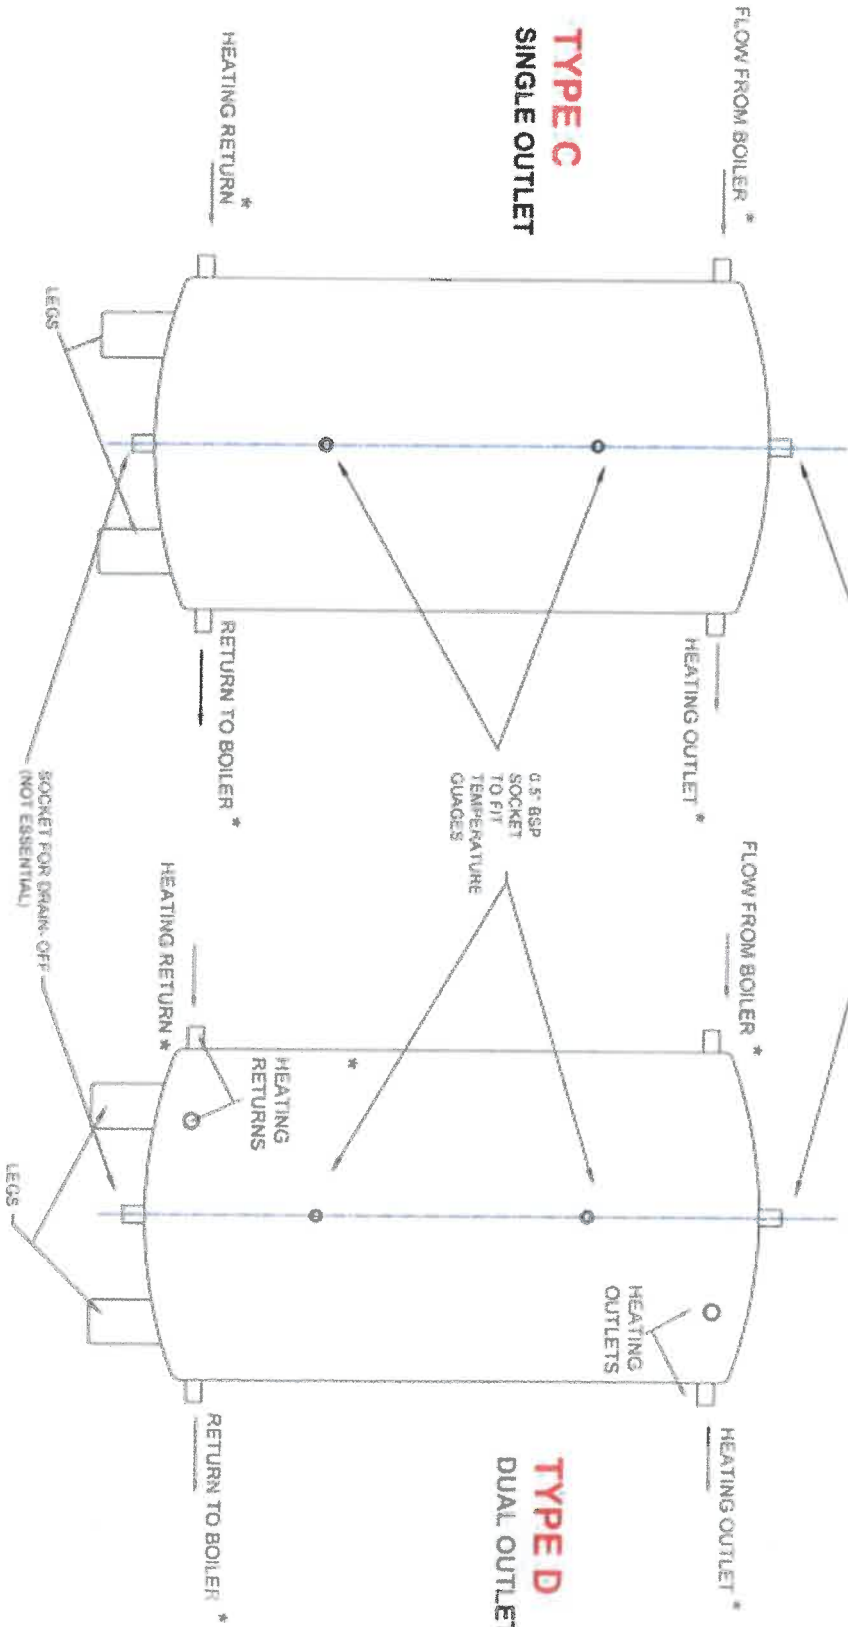

TEISEN PRODUCTS LTD. PROVIDE THIS DRAWING FOR GENERAL GUIDANCE ONLY AND ACCEPT NO RESPONSIBILITY FOR ITS FUNCTION OR PERFORMANCE.

**FARM2000**  
 MAIN PRODUCTS (SUSSEX) LTD  
 Dacres, Dronowson, Vines, BN1 8RT  
 Tel: 01243 81021 Fax: 01243 81095

This copy of this drawing is the exclusive property of M&K Products Ltd and the acceptance of this print constitutes an agreement that it will be treated as a confidential document to be used for no other purpose other than and in the assembly or operation of the equipment of its manufacture expressly authorized by M&K Products Ltd. These drawings are not to be communicated, disclosed, copied or published except as expressly authorized in writing by M&K Products Ltd

No.	DATE	ALTERATION

TITLE	DATE	SCALE
TYPICAL VERTICAL ACCUMULATOR TANKS	01/13	1:30

USED ON	DWG No.
	<b>C &amp; D</b>